


- GENERAL NOTES:**
1. ALL CONSTRUCTION MUST BE DONE ACCORDANCE WITH SANS 1200.
 2. ALL WATER PIPES TO BE 160mm(EXCEPT WHERE SHOWN OTHERWISE) PVC-M - CLASS 12.
 3. ALL EXISTING CONNECTIONS, PIPE SIZE AND TYPE TO BE VERIFIED ON SITE BEFORE ANY CONSTRUCTION COMMENCES.
 4. VALVES SHALL BE CONSTRUCTED ON CORNER OF SPLAYS.
- LEGEND:**
- PROPOSED SERVICES:
- WATER MAINS
 - VALVE
 - FIRE HYDRANT
 - END CAP
 - 100 YEAR FLOOD LINE
 - 50 YEAR FLOOD LINE



Plot Date: 31/10/2024 4:02:21 PM Client: ZAGSU Filename: P:\PROJECTS\504255 - ERF 464 GEORGE REZONING\DWG\DWG\504255-0000-DRG-CC-001.dwg

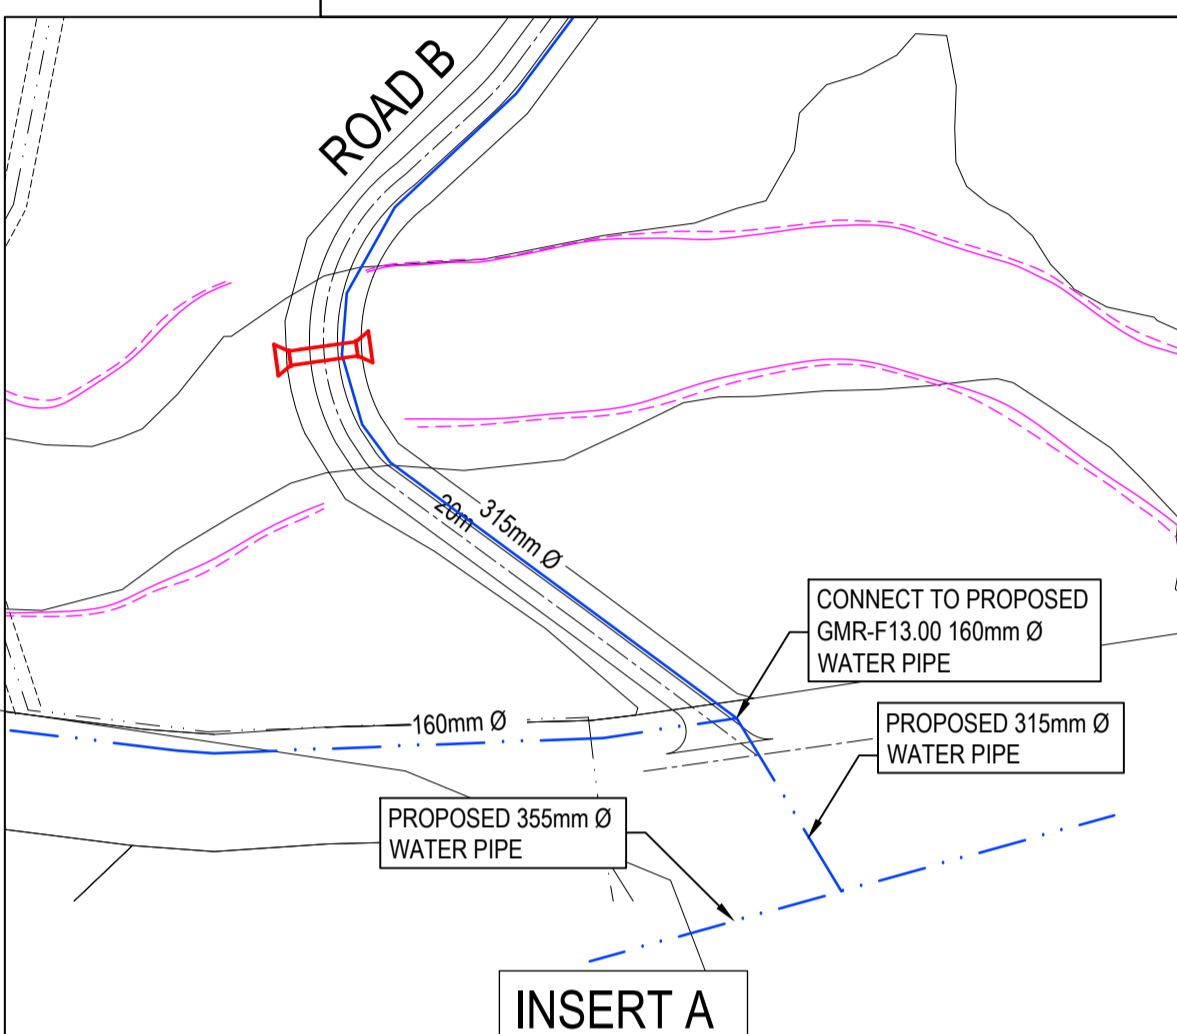

CLIENT
GEORGE MUNICIPALITY

REV	DATE	REVISION DETAILS
A	16/1/2020	PRELIMINARY

APPROVED A KEYSER	SCALE 1:2000	SIZE A1
DRAWN A. VAN WYK	DESIGNED S. JOHNSON	REVIEWED M. BOTHA

PRELIMINARY
NOT FOR CONSTRUCTION

APPROVED _____ DATE _____

AC KEYSER ECSA-200670108

PROJECT	ERF 464 GEORGE REZONING				
TITLE	WATER LAYOUT				
DRAWING No.	PROJECT No.	WBS	TYPE	DISC	NUMBER
504255	504255	0000	DRG	CC	0003
REV	A				